
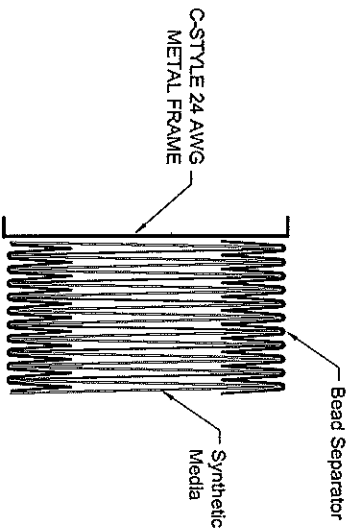


MODEL NUMBER	CONSTRUCTION CODE	NOMINAL SIZE (INCHES) HXWxD	ACTUAL SIZE (INCHES) HXWxD	RATED AIR FLOW (CFM)	INITIAL RESISTANCE (IN. W.G.)	MEDIA AREA (SQUARE FEET)	Efficiency @ 0.3 Micron
UCLR-4412E-MC	UCGLVLR-24024012-XBU-GND-00-00	24X24X12	24X24X11-1/2	2000	.53	122	99% +
UCLR-4412-MC	UCGLVLR-23F23F12-XBU-GND-00-00	24X24X12	23-3/8X23-3/8X11-1/2	2000	.54	116	99% +
UCLR-0412-MC	UCGLVLR-23F19F12-XBU-GND-00-00	24X20X12	23-3/8X19-3/8X11-1/2	1640	.53	100	99% +
UCLR-0012-MC	UCGLVLR-19F19F12-XBU-GND-00-00	20X20X12	19-3/8X19-3/8X11-1/2	1400	.53	83	99% +
UCLR-2412E-MC	UCGLVLR-24012012-XBU-GND-00-00	24X12X12	24X12X11-1/2	1000	.53	61	99% +
UCLR-2412-MC	UCGLVLR-23F11F12-XBU-GND-00-00	24X12X12	23-3/8X11-3/8X11-1/2	1000	.54	56	99% +

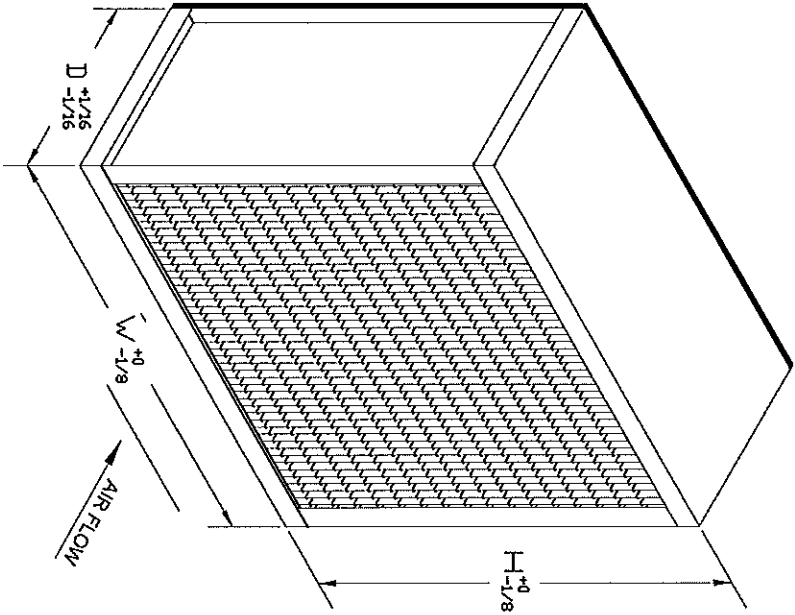

Filter Cross Section

**STANDARD CONSTRUCTION**

1. 100% Synthetic Media
2. Bead Separator Packs
3. 24 AWG galvanized metal box frame
4. Urethane Sealant
5. 1/4 x 3/4 neoprene gasket down stream
6. Other gasket locations optional

**NOTES**

1. Testing per LMS 2000 using emery oil, neutralized
2. Standard final resistance 1.5" W.C.
3. Optimal final resistance 1.06" W.C.
4. Rated Velocity - 500 FPM
5. Maximum Operating Temperature: 180 deg. F
6. Class 2 Filter per UL Standard 900
7. Contact factory for special sizes



100 River Ridge Circle  
Jeffersonville, IN 47130  
P: 866-925-2247  
F: 502-961-0930  
www.puroator.com

CONTACT FACTORY TO  
VERIFY REVISION LEVEL

TOLERANCES  
UNLESS OTHERWISE SPECIFIED

FRACTIONAL	-
DECIMAL	-
ANGLES	-

ALL DIMENSIONS IN INCHES

DRAWING NAME

ULTRA CELL LR METAL BOX FRAME

APPROVED BY

*KQA*

SPECIFICATION NO.

MKT-P-00587

REVISION DATE

1/15/2010

SCALE

NONE

DWG. SIZE

A

REVISION

NEW

PAGE

1 OF 1

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY C.A.C.A.R. THE DISSEMINATION OF THE INFORMATION CONTAINED HEREIN IS PROHIBITED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.